



SNR-013-1 Thermowell
12" Probe
SNR-013-2 Thermowell
16" Probe

Side View

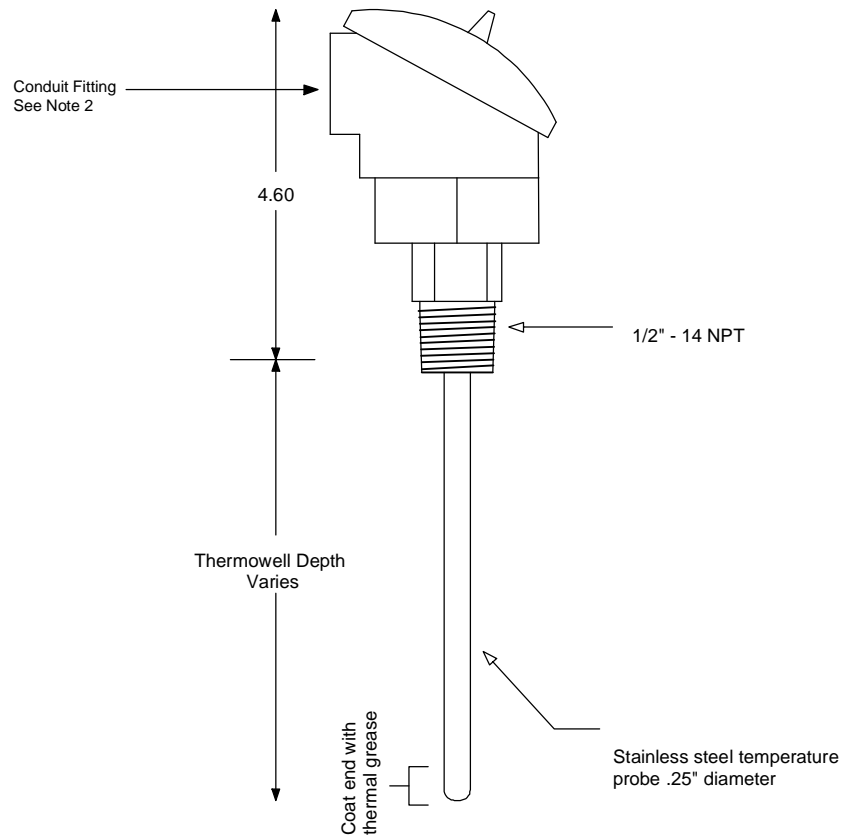

Front View

(Cover removed)

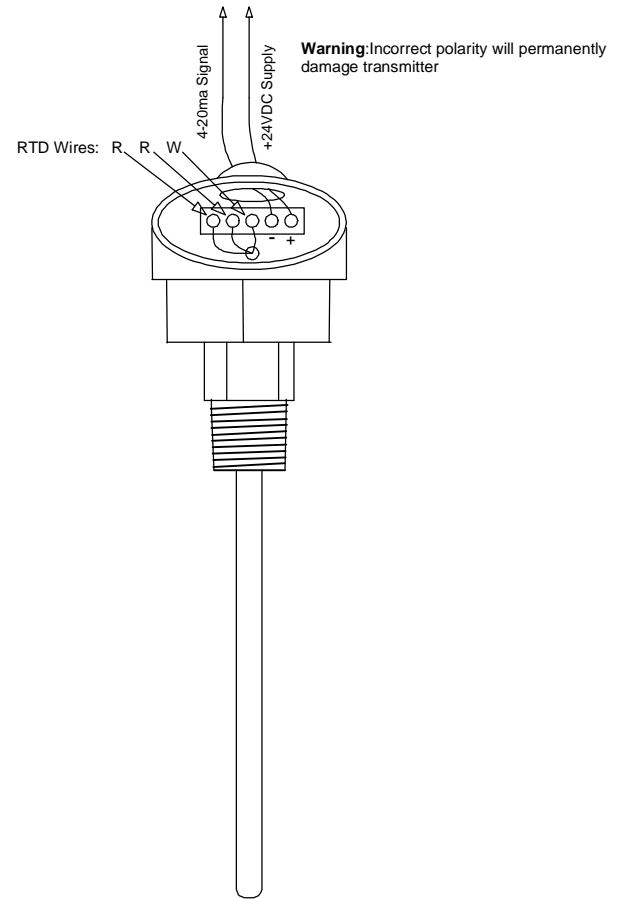

NOTES:

- 1) Requires 2 conductor #24 AWG shielded cable Belden 9501 or equal up to 2000' in length. Ground shield at control panel end only. Insulate shield at sensor end.
- 2) Conduit fitting must face down for installation. Appropriate water tight conduit fittings must be used.
- 3) Warning: Sensor must be protected from ingress of moisture. The conduit entering the sensor must be sealed internally with foam or putty to completely prevent air movement. Moisture damage is not cover by warranty.



© Copyright 2007 Logix® All Rights Reserved.

CONFIDENTIAL: The information herein is confidential and may NOT be reproduced or divulged without the written permission of The Controls Group, Inc. LOGIX is a registered trademark of The Controls Group, Inc.

Title Pyromation Thermowell Temperature Sensor Wiring & Installation Detail Logix P/N SNR-013		
Date 09/12/2007	Rev 01A	Drawn by MAG
Drawing Filename SNR-013_WineThermowellTemp.axd		